

# NEW PHOTOVOLTAIC GROUND MOUNTED SYSTEM - 9.84 KW DC/8.376 KW AC

## 64 ISLAND FARMS RD, WEST TISBURY, MA 02575

CONTRACTOR



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY, MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690


**NEW PV SYSTEM SPECIFICATIONS**  
 SYSTEM SIZE: DC SIZE: 9.840 KW DC-(STC)  
 AC SIZE: 8.376 KW AC  
 MODULE: (24) HYUNDAI SOLAR HIS-S410YH(BK)  
 INVERTER: (24) ENPHASE IQ8A-72-2-US [240V]

**PROJECT NOTES**  
 1.1.1 THIS PHOTOVOLTAIC (PV) SYSTEM SHALL COMPLY WITH THE RELEVANT YEAR OF THE NATIONAL ELECTRIC CODE (NEC), ALL MANUFACTURER'S LISTING AND INSTALLATION INSTRUCTIONS, AND THE RELEVANT CODES AS SPECIFIED BY THE AUTHORITY HAVING JURISDICTION'S (AHJ) APPLICABLE CODES.  
 1.1.2 THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND THE PV SYSTEM MUST BE INSPECTED PRIOR TO OPERATION  
 1.1.3 ALL PV SYSTEM COMPONENTS; MODULES, UTILITY-INTERACTIVE INVERTERS, AND SOURCE CIRCUIT COMBINER BOXES ARE IDENTIFIED AND LISTED FOR USE IN PHOTOVOLTAIC SYSTEMS AS REQUIRED BY NEC AND OTHER GOVERNING CODES  
 1.1.4 ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.

**SCOPE OF WORK**  
 1.2.1 CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE GRID-TIED PHOTOVOLTAIC SYSTEM. THE CONTRACTOR WILL BE RESPONSIBLE FOR COLLECTION OF EXISTING ONSITE CONDITIONS TO DESIGN, SPECIFY, AND INSTALL THE GROUND-MOUNTED PHOTOVOLTAIC SYSTEM DETAILED IN THIS DOCUMENT

**APPLICABLE CODES**  
 ALL WORK SHALL CONFORM TO THE FOLLOWING CODES:  
 2015 INTERNATIONAL BUILDING CODE W/ 780 CMR  
 2015 INTERNATIONAL RESIDENTIAL CODE W/ 780 CMR  
 2015 INTERNATIONAL EXISTING BUILDING CODE W/ 780 CMR  
 2018 INTERNATIONAL ENERGY CONSERVATION CODE  
 2018 INTERNATIONAL FIRE CODE  
 2020 NATIONAL ELECTRICAL CODE  
 AS ADOPTED BY TOWN OF WEST TISBURY

**DESIGN CRITERIA**  
 GROUND SNOW LOAD: 50 PSF  
 WIND SPEED: 140 MPH  
 WIND EXPOSURE: B  
 RISK CATEGORY: II

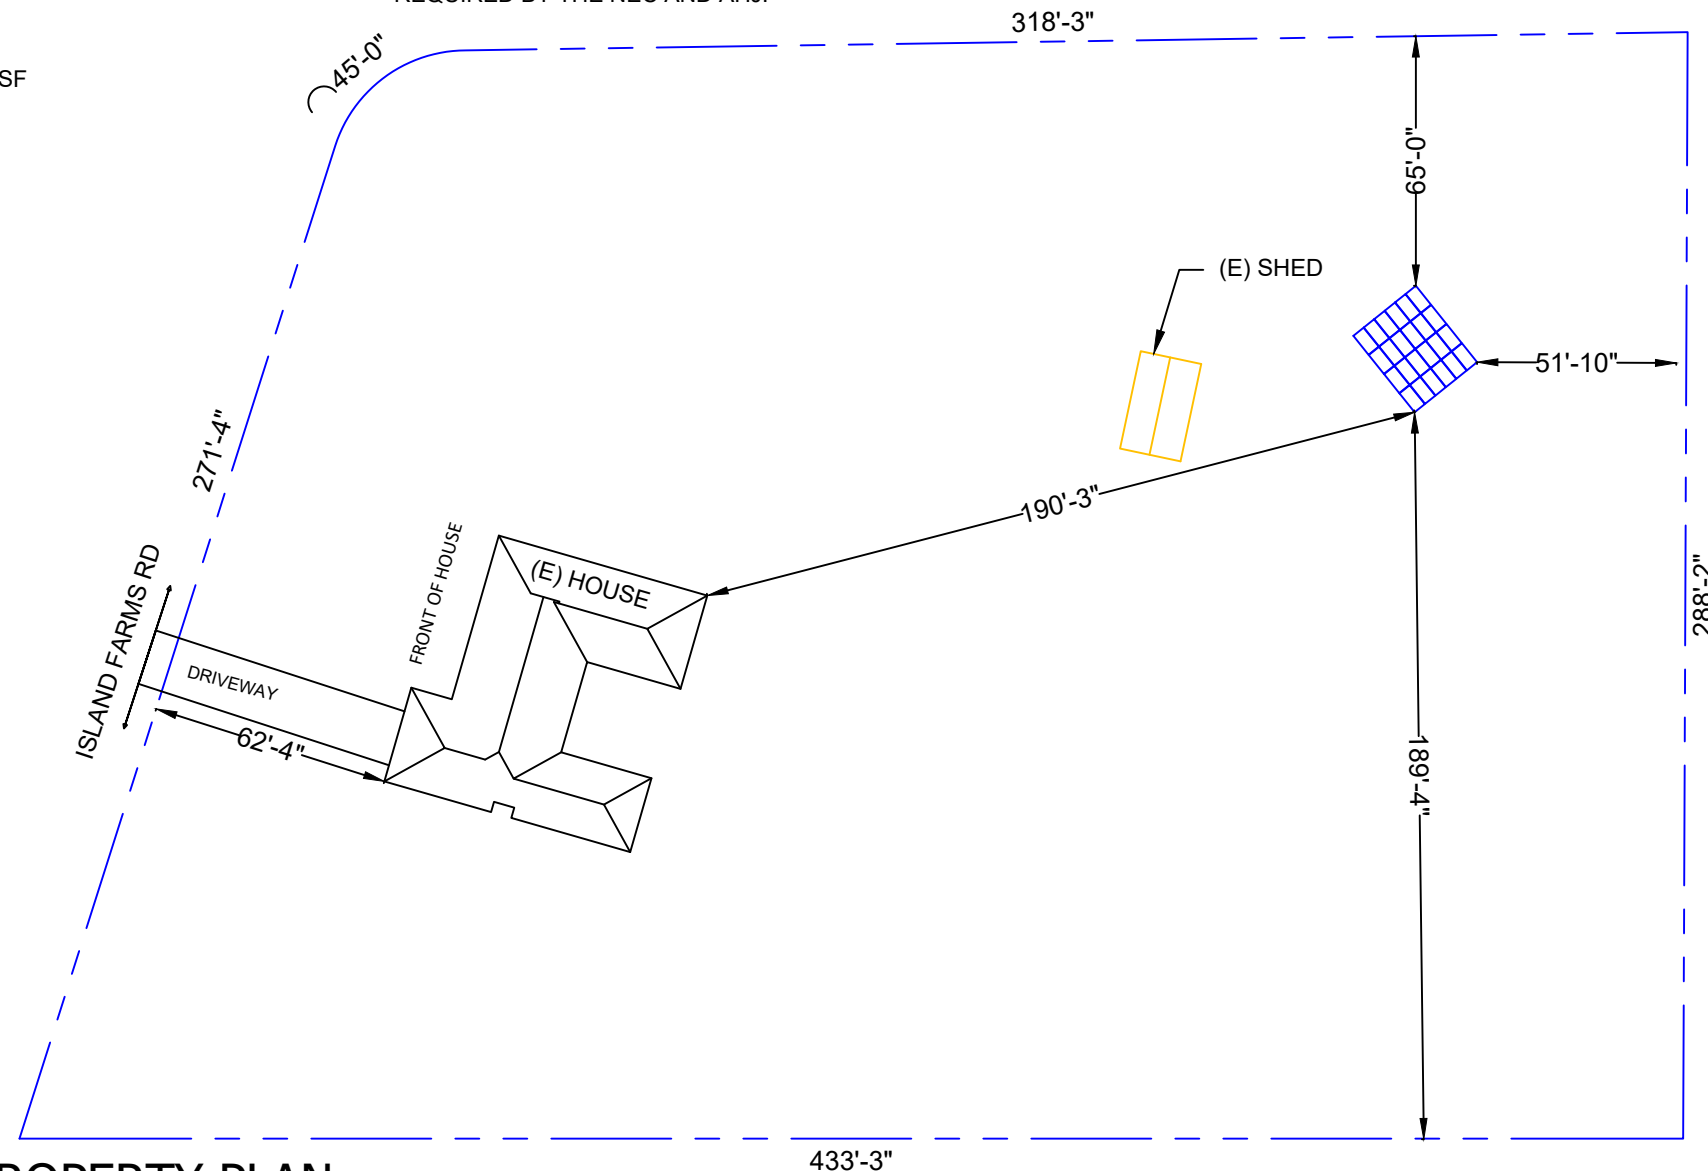


### SHEET INDEX

PV-01	COVER PAGE
PV-02	SITE PLAN
PV-3.0	ATTACHMENT PLAN & DETAILS
PV-3.1	ATTACHMENT PLAN & DETAILS
PV-04	ELECTRICAL DIAGRAM
PV-05	NOTES
PV-06	WARNING LABELS
PV-07	INSTALLATION RESOURCE
EQUIPMENT DATASHEETS ATTACHED	


### LEGEND

	- PROPERTY LINE
	- FENCE LINE

### VICINITY MAP

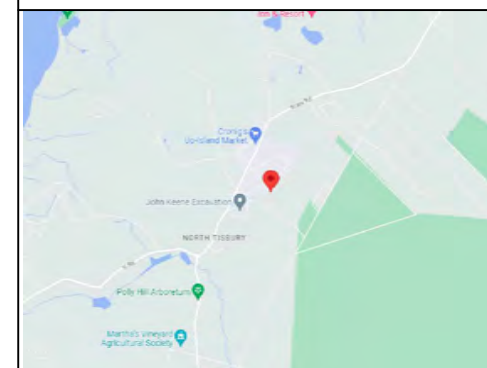

### SATELLITE MAP

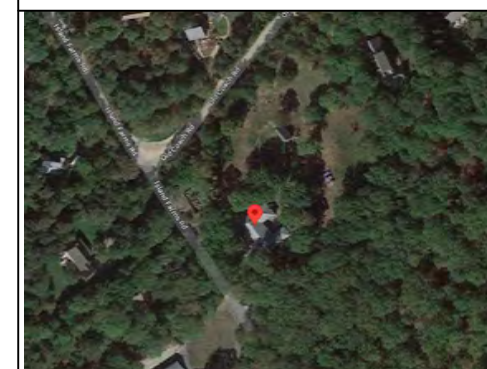

### PROJECT NAME & ADDRESS

RICH HUFFAM  
 64 ISLAND FARMS RD,  
 WEST TISBURY, MA 02575  
 APN #: WTISM00016B00017L00000  
 AHJ: TOWN OF WEST TISBURY  
 UTILITY: EVERSOURCE

### SYSTEM DETAILS

DC SIZE: 9.840 KW DC-(STC)  
 AC SIZE: 8.376 KW AC  
 (24) HYUNDAI SOLAR HIS-S410YH(BK)  
 (24) ENPHASE IQ8A-72-2-US [240V]

### REVISIONS

REV	DESCRIPTION	DATE

### SHEET TITLE

**COVER PAGE**

DRAWN DATE	2/1/2024
DRAWN BY	PCAD

### SHEET NUMBER

**PV-01**




**1** PROPERTY PLAN  
 PV-01  
 SCALE: 1"=50'-0"

**NOTES:**

- STRUCTURES, PATIO COVERS, AND/OR ADDITIONS BUILT WITHOUT PERMITS TO BE RESOLVED BY A SEPARATE PERMIT.

**TRENCH NOTES:**

- 18" MINIMUM DEPTH OR BELOW FROST LINE.
- 24" MINIMUM DEPTH FOR CONDUIT TRENCHED UNDER AREAS SUBJECT TO VEHICLE TRAFFIC.

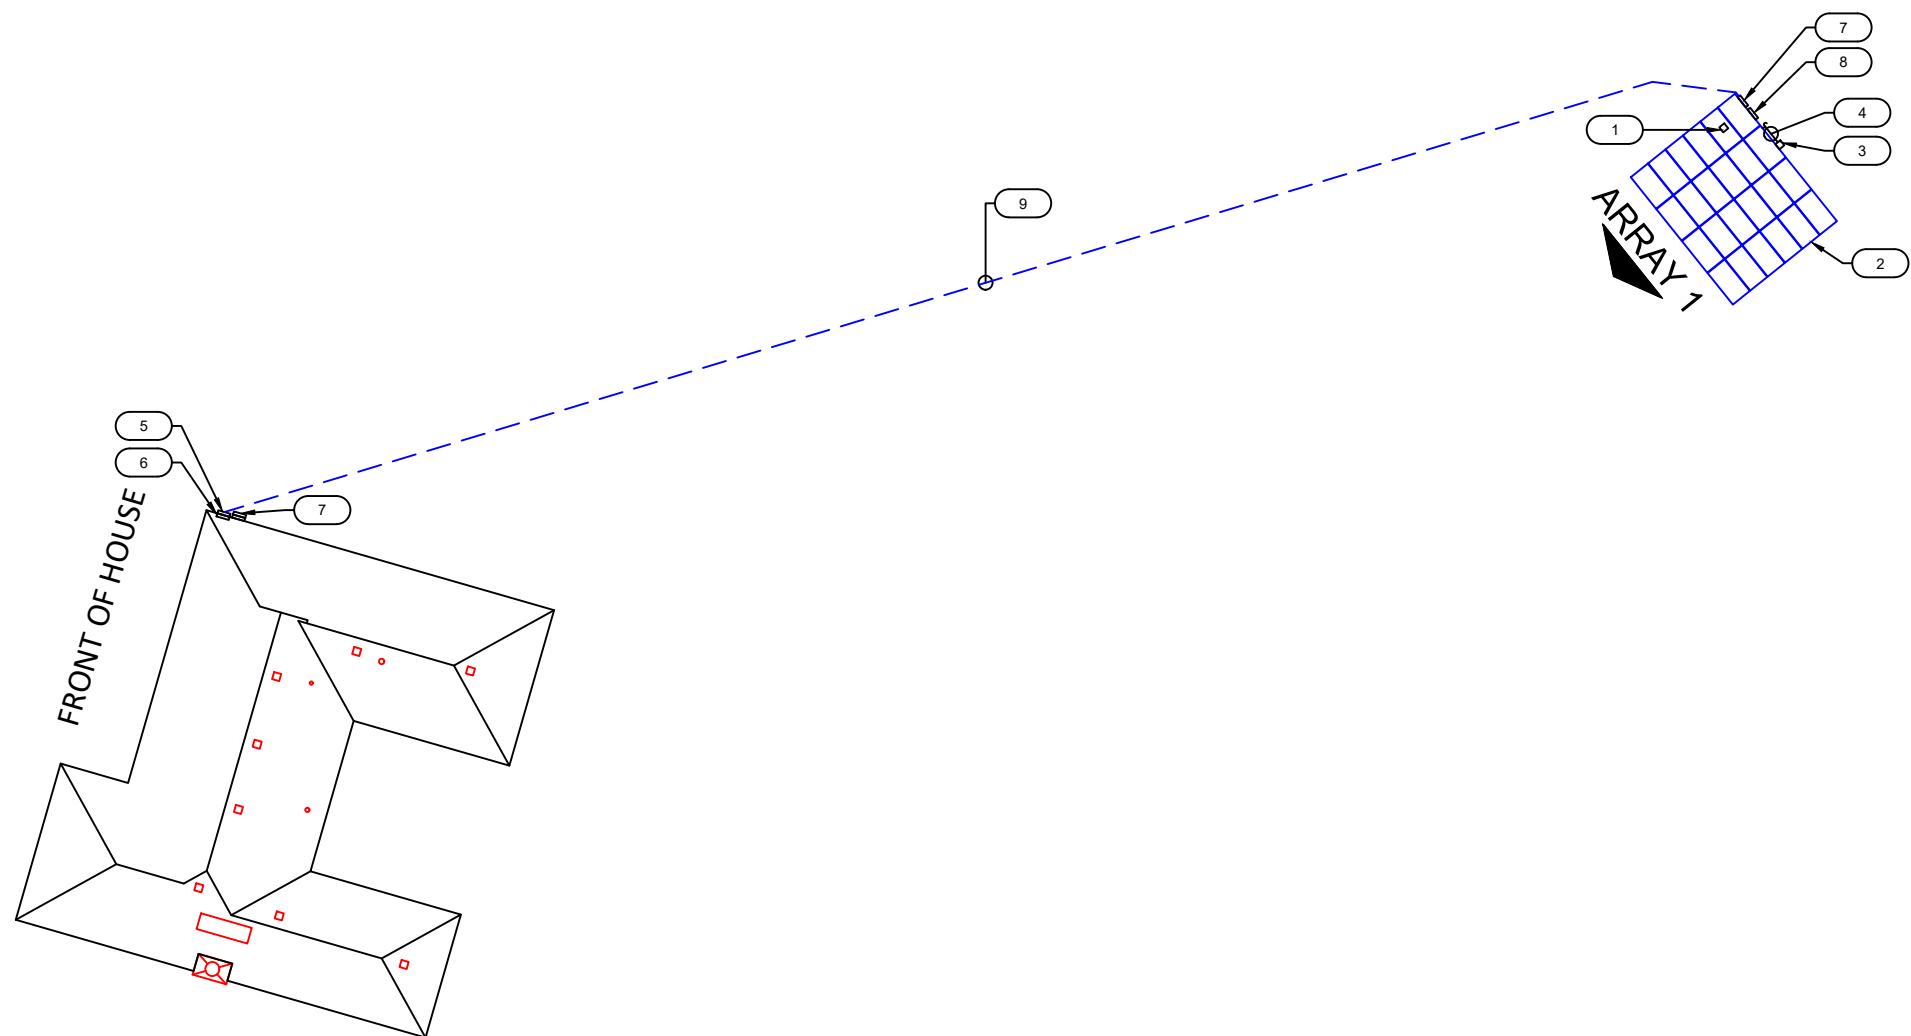


**LEGEND**

NON-DWELLING UNIT USED FOR PV SYSTEM, FIRE SETBACKS ARE NOT REQUIRED

- = MECHANICAL VENT
- = FLUE / PLUMBING VENT
- = FENCE LINE
- 1 MICROINVERTER (1 PER MODULE)
- 2 PV MODULES
- 3 JUNCTION BOX; SIZE DETERMINED IN FIELD
- 4 CONDUIT RUN; SURFACE MOUNTED (ACTUAL CONDUIT RUNS TO BE DETERMINED IN FIELD)
- 5 UTILITY METER
- 6 MAIN SERVICE PANEL
- 7 AC DISCONNECT AND PV PRODUCTION METER
- 8 AC COMBINER PANEL
- 9 246FT TRENCH

**GROUND-MOUNT ARRAY(S)**

<b>ARRAY 1</b> 	ARRAY SLOPE	- 37°
	AZIMUTH	- 180°
	MODULE QTY.	- 24

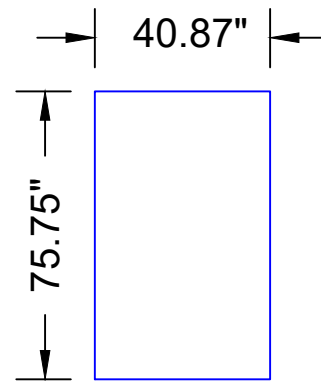

**CONTRACTOR**



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY, MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690

**PROJECT NAME & ADDRESS**

RICH HUFFAM  
64 ISLAND FARMS RD,  
WEST TISBURY, MA 02575  
APN #: WTISM00016B00017L00000  
AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

**SYSTEM DETAILS**

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

**REVISIONS**

REV	DESCRIPTION	DATE

**SHEET TITLE**

**SITE PLAN**

DRAWN DATE 2/1/2024

DRAWN BY PCAD

**SHEET NUMBER**

**PV-02**



**1** SITE PLAN  
PV-02 SCALE: 1"=30'-0"

CONTRACTOR



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY,  
MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690

**PROJECT NAME & ADDRESS**

RICH HUFFAM

64 ISLAND FARMS RD,  
WEST TISBURY, MA 02575  
APN #: WTISM00016B00017L00000

AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

**SYSTEM DETAILS**

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

**REVISIONS**


REV	DESCRIPTION	DATE

**SHEET TITLE**


DRAWN DATE 2/1/2024  
DRAWN BY PCAD

**SHEET NUMBER**


PV-03

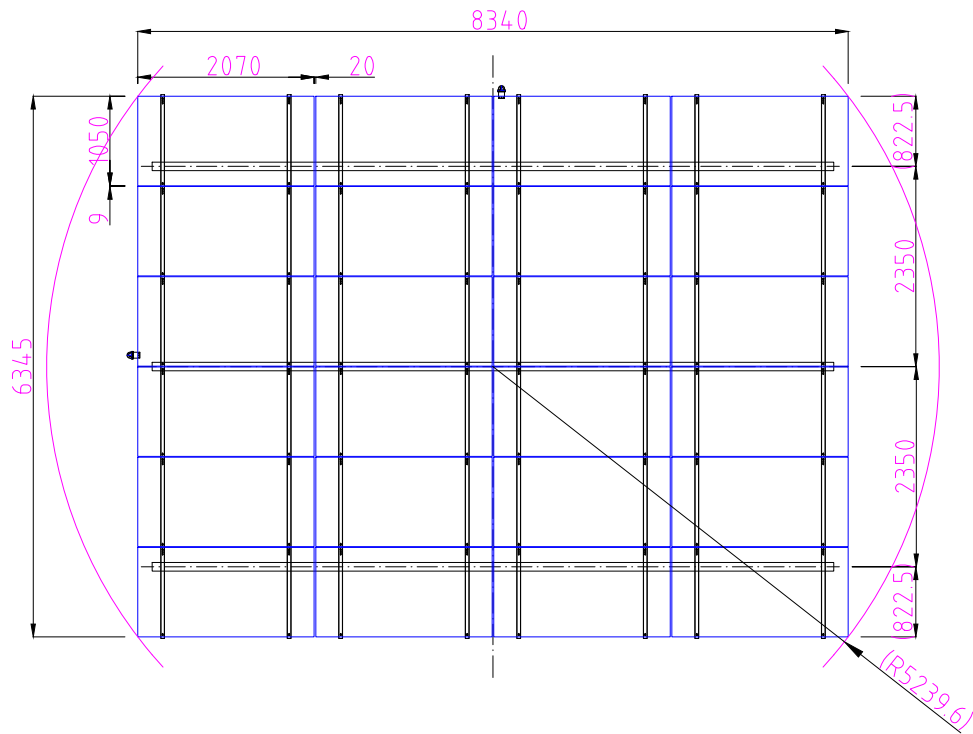


**MODULE ARRAY**

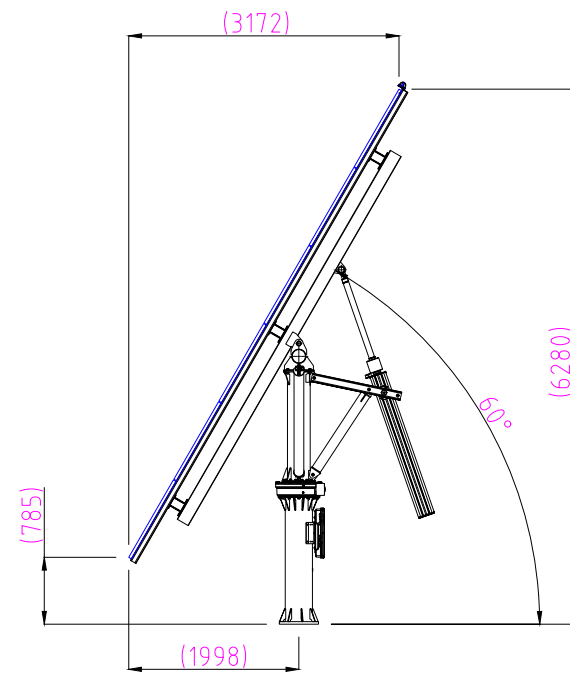


**SIDE VIEW(60\*)**

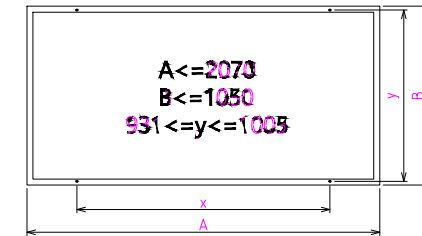


**MODULE LAYOUT**

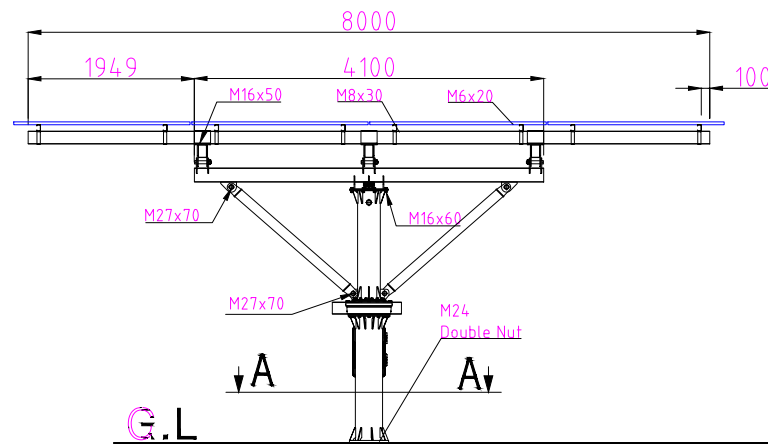

**FRONT VIEW**

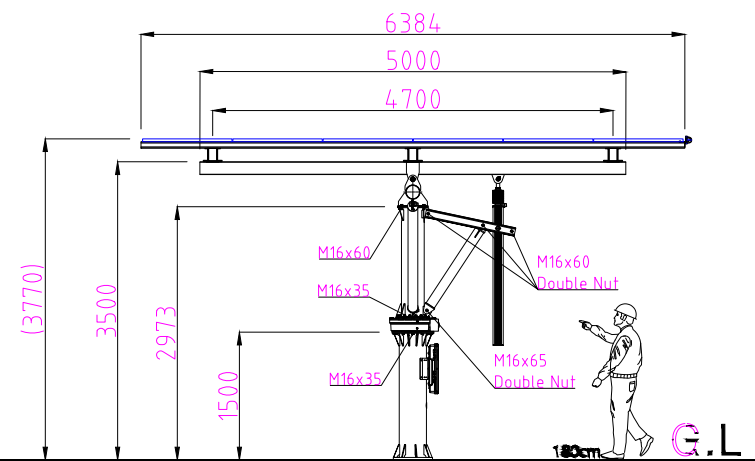

**SIDE VIEW(0\*)**

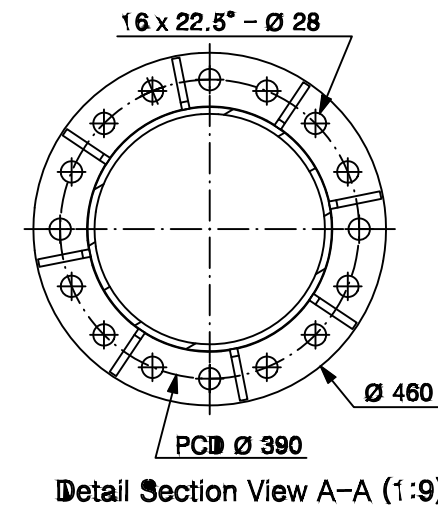

**Detail Section View A-A (1:9)**

- All dimensions in mm. Not to scale.
- Layout/Drawing is for reference use only.
- Prohibit counterfeiting, unauthorized copy, and opening public.
- Return to authorized department immediately after competing the work.
- Control strictly in accordance with classified documents.
- Should have legal responsibility for information spill without permission.

Product	DUALTRACK 24M [STANDARD V1]	Qty		Approved By	
Part Name	Layout Drawing	Material		Checked By	
DWG No.	PST-2AL-24M	Weight(Kg)		Designed By	
		General Tolerance		Drawn By	
		Projection		Date	

**CONTRACTOR**



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY,  
MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690

**PROJECT NAME & ADDRESS**

RICH HUFFAM

64 ISLAND FARMS RD,  
WEST TISBURY, MA 02575

APN #: WTISM00016B00017L00000

AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

**SYSTEM DETAILS**

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

**REVISIONS**

REV	DESCRIPTION	DATE


**SHEET TITLE**

DRAWN DATE 2/1/2024

DRAWN BY PCAD


**SHEET NUMBER**

PV-3.1

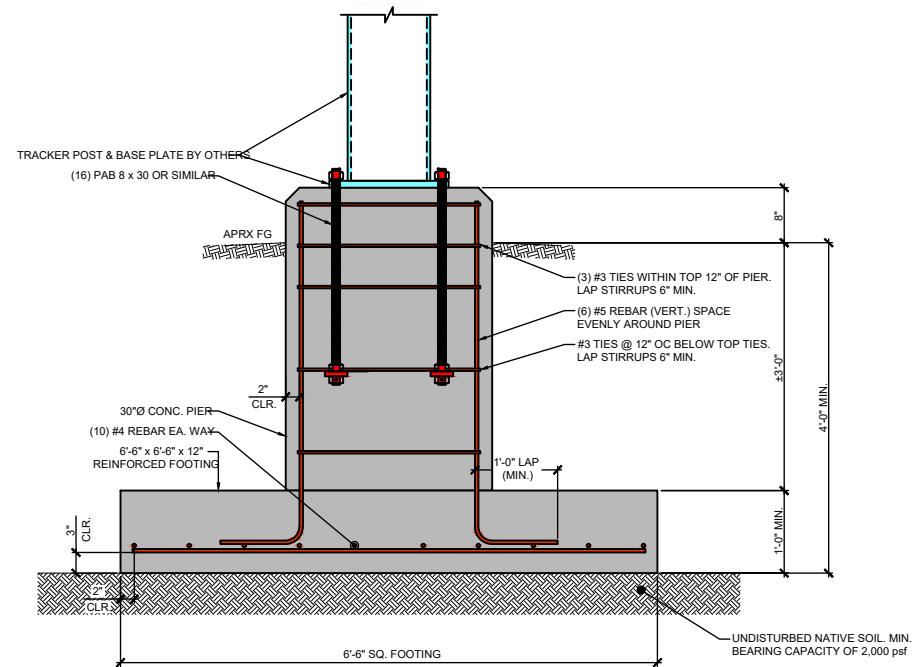

1 FOOTING/PIER SECTION

NOT TO SCALE

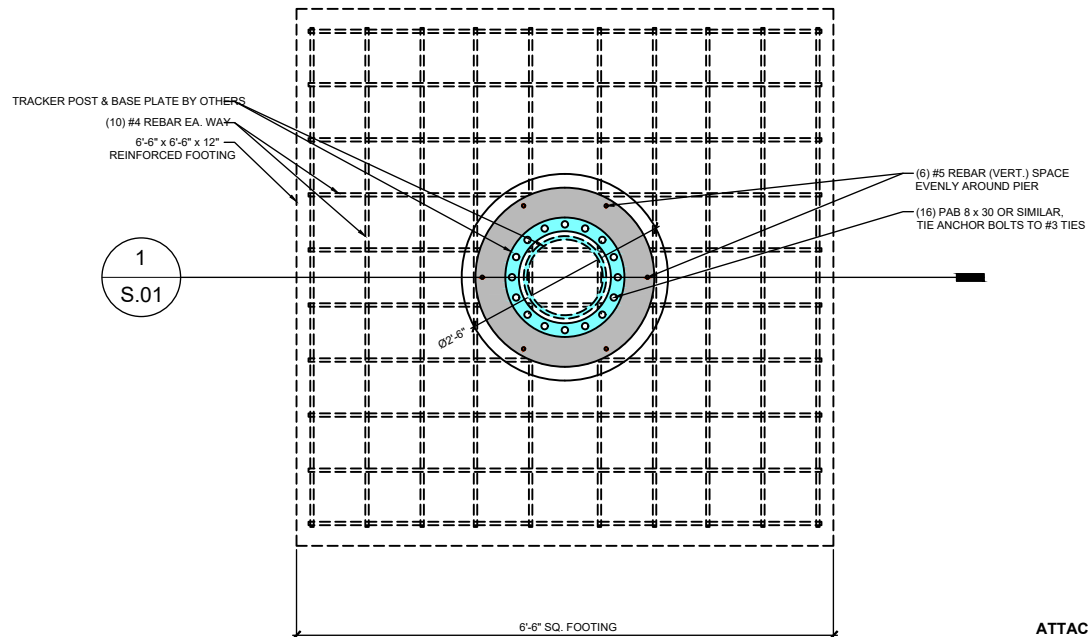

ATTACHMENT PLAN & DETAILS

2 FOOTING/PIER PLAN VIEW

NOT TO SCALE

**SOIL CLASSIFICATION NOTE**  
ALL STRUCTURES TO BE LOCATED ENTIRELY ON UNDISTURBED NATIVE SOILS. IF DISTURBED, COMPACT BELOW ALL FOOTINGS AND SLABS TO A MIN. SOIL BEARING CAPACITY OF 2,500 PSF. IF THE BUILDING INSPECTOR SUSPECTS FILL, EXPANSIVE SOIL, HIGH WATER TABLE OR ANY GEOLOGIC INSTABILITY, CONTACT THE ENGINEER ON RECORD.

**DRAINAGE NOTE**  
ENSURE SURFACE WATER IS DRAINING AWAY FROM BUILDING AND MUST FALL A MINIMUM OF 6 INCHES WITHIN THE FIRST 10 FEET FROM BUILDINGS EDGE

**SPREAD FOOTING SCHEDULE**

SYMBOL	DIMENSIONS & REINFORCEMENTS
⊠	2'-0" SQ. x 1'-0" DEEP SPREAD FOOTING w/ (2)-#4 BARS EA. WAY
⊠	2'-6" SQ. x 1'-0" DEEP SPREAD FOOTING w/ (3)-#4 BARS EA. WAY
⊠	3'-0" SQ. x 1'-0" DEEP SPREAD FOOTING w/ (4)-#4 BARS EA. WAY
⊠	3'-6" SQ. x 1'-0" DEEP SPREAD FOOTING w/ (5)-#4 BARS EA. WAY
⊠	4'-0" SQ. x 1'-0" DEEP SPREAD FOOTING w/ (6)-#4 BARS EA. WAY

**STRUCTURAL DESIGN CRITERIA**

- BUILDING CODE: MASSACHUSETTS STATE BUILDING CODE (MSBC) & THE INTERNATIONAL RESIDENTIAL CODE EDITION 2015 (IRC)
- LOADS:
  - a. ARRAY DEAD LIVE / SNOW SELF WEIGHT 25 PSF
- WIND LOADS:
  - a. BASIC WIND SPEED = 125 MPH - EXPOSURE B AS PER MSBC
- CONCRETE MINIMUM 28-DAY COMPRESSIVE STRENGTH, f<sub>c</sub>:
  - a. FOOTINGS 3,000 PSI
  - b. FOUNDATION WALLS 3,000 PSI
  - c. SLAB-ON-GRADE 3,000 PSI
  - d. HONEY-COMBING, SPALLS, CRACKS ETC. SHALL BE REPORTED TO THE STRUCTURAL ENGINEER.
- STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR THE DESIGN OR CONSTRUCTION OF SYSTEMS NOT SHOWN IN STRUCTURAL PLANS.
- MATERIAL, WORKSMANSHIP, AND DESIGN SHALL CONFORM TO THE REFERENCED BUILDING CODES.
- FOR DIMENSIONS NOT SHOWN ON THE STRUCTURAL DOCUMENTS, REFER TO DOCUMENTS BY OTHERS.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES OF CONSTRUCTION.
- THE STRUCTURE IS ONLY STABLE IN ITS COMPLETED FORM. TEMPORARY SHORING & SUPPORT MAY BE REQUIRED DURING INTERMEDIATE STAGES OF CONSTRUCTION.

**REBAR COVER TABLE 20.6.1.3.1 (AS PER ACI)**

CONCRETE EXPOSURE	MEMBER	REINFORCEMENT	SPECIFIED COVER, IN.
CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND	ALL	ALL	3
EXPOSURE TO WEATHER OR IN CONTACT WITH GROUND	ALL	#6 THROUGH #18 REBAR	2
		#5 REBAR, W31D31 WIRE AND SMALLER	1-1/2
	SLABS, JOISTS AND WALLS	#14 AND #18 REBAR	1-1/2
		#11 REBAR AND SMALLER	3/4
NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND	BEAMS, COLUMNS, PEDESTALS AND TENSIONALS AND	PRIMARY REINFORCEMENT, STIRRUPS, TIES, SPIRALS AND HOOPS	1-1/2

**GENERAL NOTES & DESIGN CRITERIA**

- THE PLANS THAT FOLLOW ARE DESIGNED TO SUPPORT A SUN-ACTION (MANUFACTURER) 24 DUAL AXIS TRACKING SYSTEM AND HAS BEEN DESIGN AS PER THE CRITERIA LISTED BELOW:  
AS PER ASCE 7-16  
RISK CATEGORY 1  
BASIC WIND SPEED (V) 125 MPH (INTERPOLATED FROM FIGURE 26.5-1A)  
DESIGNED WIND SPEED (V) 105 MPH (IN "STOW" POSITION (°))  
40 MPH (AT ALL OTHER POSITIONS)
- WIND DIRECTIONALITY FACTOR (K<sub>d</sub>) 0.85  
SURFACE ROUGHNESS (K<sub>s</sub>) B  
EXPOSURE CATEGORY (K<sub>e</sub>) 1.0  
GROUND ELEVATION FACTOR (K<sub>z</sub>) 1.0  
TOPOGRAPHIC FACTOR (K<sub>t</sub>) 1.0  
VELOCITY PRESSURE COEFF. (K<sub>z</sub> & K<sub>t</sub>) 0.85  
GUST-EFFECT FACTOR (G<sub>f</sub>) 0.85  
VELOCITY PRESSURE (Q<sub>z</sub>) 28.9 PSF (EQUATION 26.10-1)  
FORCE COEFFICIENT (C<sub>f</sub>) 1.3 (FIGURE 29.4-1)  
DESIGN WIND FORCE (F<sub>w</sub>) 15,783 LBS (EQUATION 29.4-1)
- MARTHA'S VINEYARD ENGINEERING & DESIGN (MV E&D) IS NOT RESPONSIBLE FOR THE TRACKER COMPONENTS ABOVE THE FOOTING/CONCRETE PIER NOR THE ANCHORAGE DESIGN TO THE FOOTING/CONCRETE PIER. MV E&D IS NOT RESPONSIBLE FOR THE TRACKERS ABILITY TO REACH THE "STOW" OR "SHED" POSITIONS. FAILURE TO REACH THESE POSITIONS DURING HIGH WIND EVENTS COULD CAUSE DAMAGE TO THE TRACKER AND THE SUPPORT FOOTING(S).
- CONTRACTOR IS RESPONSIBLE FOR ALL DIMENSIONS, SITE CONDITIONS AND SHALL NOTIFY THE MANUFACTURER AND/OR ENGINEER IF ANY DISCREPANCIES ARE DISCOVERED ON SITE.
- THE FOUNDATION/CONCRETE PIER IS DESIGNED AS A FINISHED PRODUCT. TEMPORARY SHORING OR RETAINING OF EARTH DURING CONSTRUCTION IS THE RESPONSIBILITY OF THE CONTRACTOR.
- NO PIPES, CONDUIT, ETC. SHALL BE PLACED IN THE FOUNDATION PIER OR FOOTING UNLESS SPECIFIED AND APPROVED BY THE ENGINEER.

**GLOSSARY**

ALT - ALTERNATING	IEBC - INTERNATIONAL EXISTING BUILDING CODE
ARCH, ARCH'L - ARCHITECT / ARCHITECTURAL	INT. - INTERIOR
B, BTM - BOTTOM	IRC - INTERNATIONAL RESIDENTIAL CODE
BTM - BOTH WAYS	KIP, K - 1,000 POUNDS
B.N. - BOUNDARY NAILING	LB. - POUND
B.O. - BOTTOM OF	LSL - LAMINATED STRAND LUMBER
BL'KG - BLOCKING	MAX. - MAXIMUM
BM - BEAM	MIN. - MINIMUM
B.P. - BASE PLATE	MSBC - MASSACHUSETTS STATE BUILDING CODE
C.J. - CEILING JOIST	MSL. - MEAN SEA LEVEL
- CENTER LINE	(N) - NEW
COL. - COLUMN	O.C. - ON CENTER
CONN. - CONNECTION	PCF - POUNDS PER CUBIC FOOT
D.J. - DECK JOIST	PENE. - PENETRATION
DEV. - DEVELOPMENT	PL. - PLATE
DIA., Ø - DIAMETER	PLF - POUNDS PER LINEAR FOOT
DIR. - DIRECTION	PLY - PLYWOOD
DN. - DOWN	PSF - POUNDS PER SQUARE FOOT
EA. - EACH	PT - PRESSURE TREATED
ECT. - ETETERA	REINF. - REINFORCED / REINFORCEMENT
ELEV. - ELEVATION	REQD. - REQUIRED
EMBED. - EMBEDDED	R.O. - ROUGH OPENING
E.N. - END NAILING	R.R. - ROOF RAFTER
E.O.R. - ENGINEER OF RECORD	SF - SUBFLOOR
EQ. - EQUALLY	STAGG. - STAGGERED
EXIST., (E) - EXISTING	STR. - STRUCTURAL
EXT. - EXTERIOR	T/ - TOP
F.J. - FLOOR JOIST	T/B - TOP & BOTTOM
F.N. - FINISHED GRADE	T.O. - TOP OF
F.G. - FINISHED GRADE	T & G - TONGUE AND GROOVE
GALV. - GALVANIZED	TBD - TO BE DETERMINED
GLB. - GLULAM BEAM	TBR. - TO BE REMOVED
HDR. - HEADER	T.P. - TOP PLATE
HORIZ. - HORIZONTAL	TYP. - TYPICAL
IBC - INTERNATIONAL BUILDING CODE	V.I.F. - VERIFY IN FIELD
	w/ - WITH





MICROINVERTER SPECIFICATIONS	
MANUFACTURER / MODEL #	ENPHASE IQ8A-72-2-US [240V]
INPUT POWER RANGE	295W-500W
MIN/MAX START VOLTAGE	22V/58V
NOMINAL AC VOLTAGE	240V
MAX CONT. OUTPUT CURRENT	1.45A
MAX CONT. OUTPUT POWER	349W
MAX MODULES PER STRING	11 (11 MICROINVERTERS)

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL #	HYUNDAI SOLAR HIS-S410YH(BK)
VMP	38.1V
IMP	10.76A
VOC	45.9V
ISC	11.40A
TEMP. COEFF. VOC	-0.268%/°C

AMBIENT TEMPERATURE SPECIFICATIONS	
RECORD LOW TEMP	-17°C
AMBIENT TEMP (HIGH TEMP 2% AVG.)	27°C

CONTRACTOR



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY,  
MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690

PROJECT NAME & ADDRESS

RICH HUFFAM

64 ISLAND FARMS RD,  
WEST TISBURY, MA 02575  
APN #: WTISM00016B00017L00000

AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

SYSTEM DETAILS

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE  
ELECTRICAL  
DIAGRAM

DRAWN DATE 2/1/2024

DRAWN BY PCAD

SHEET NUMBER

PV-04


(250 ft RUN)

$$V_d = \frac{2 \times 12.9 \times 250 \times 43.5A}{41740} = 6.72 \text{ volts}$$

$$\% \text{ VOLTAGE DROP} = \frac{6.72 \text{ volts}}{240 \text{ volts}} \times 100 = 2.80\%$$

$$\text{Voltage @ Load: } 240 \text{ volts} - 4.4 \text{ volts} = 233.28 \text{ volts}$$

ROMEX CAN BE USED IN LIEU OF CONDUIT FOR INTERIOR BUILDING AND ATTIC RUNS ONLY. DO NOT USE ROMEX IN CONDUIT OR OUTDOOR ENVIRONMENTS.

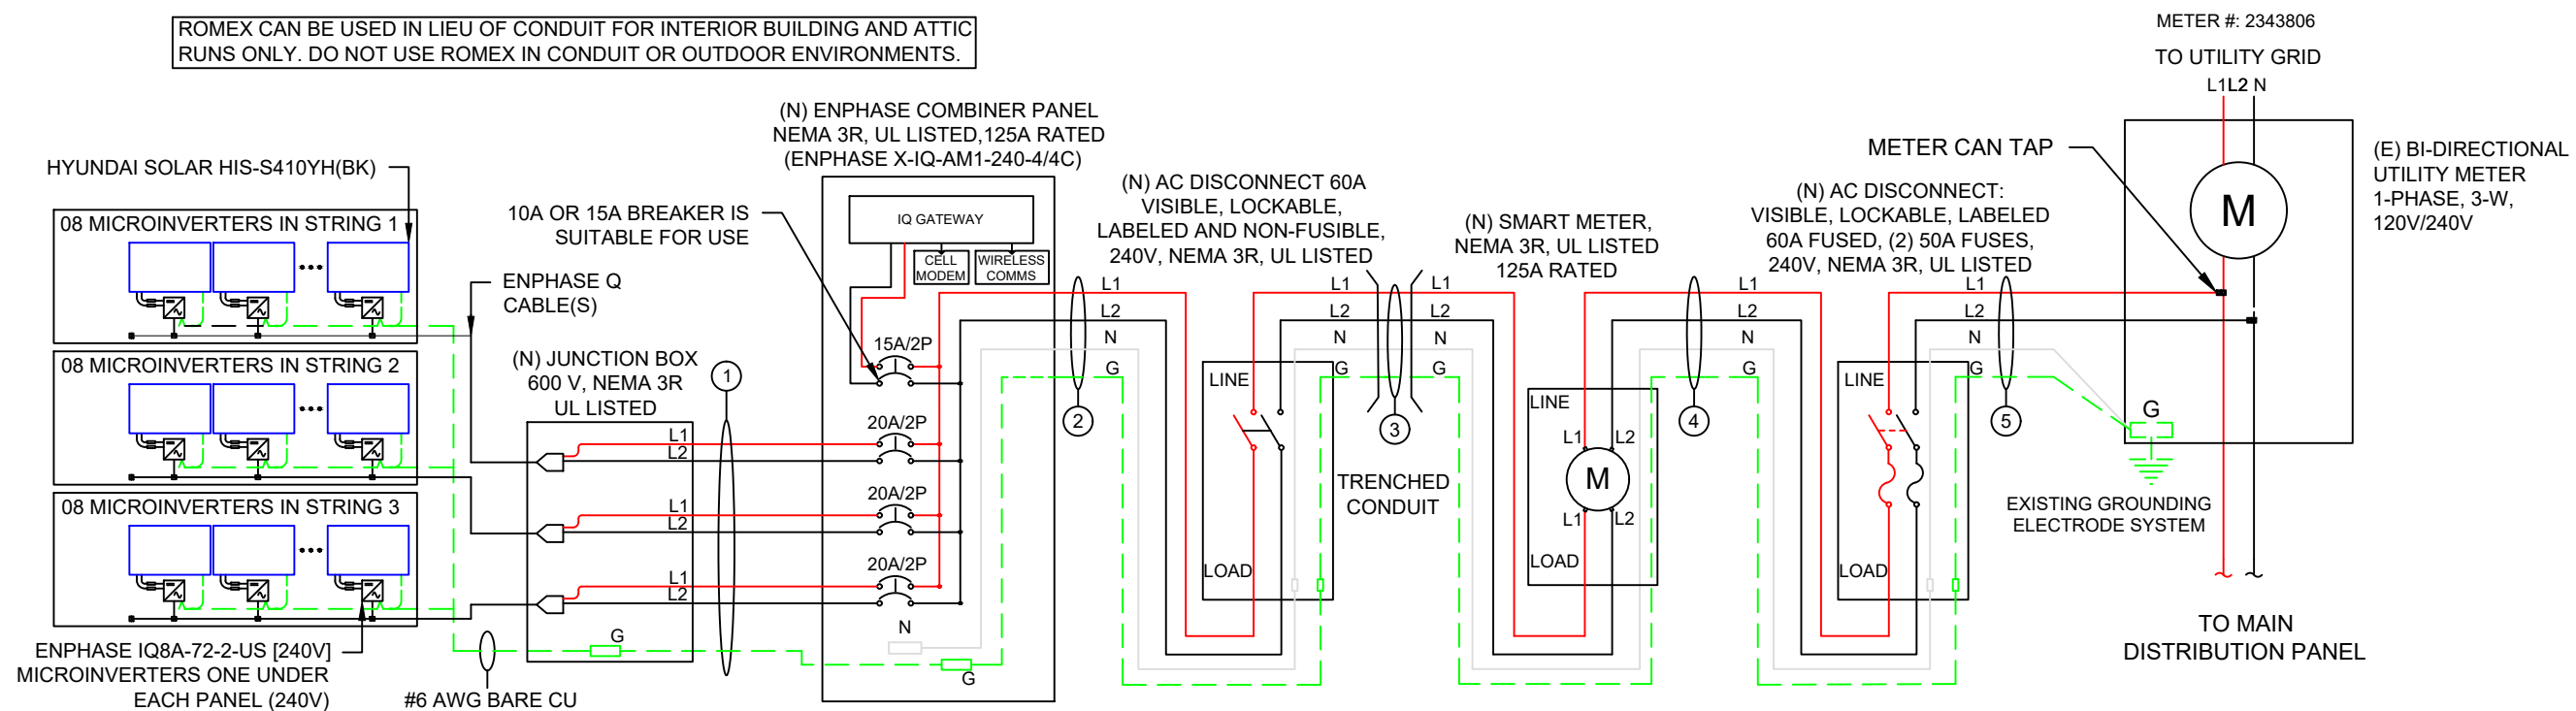

DESCRIPTION					FORMULA					RESULT		
PV OVERCURRENT PROTECTION NEC 690.9(B)					TOTAL INVERTER OUTPUT CURRENT x 1.25 = (24 x 1.45)A x 1.25					43.50A (SELECTED OCPD = 50A)		
WIRE ID	EXPECTED WIRE TEMP (°C)	TEMP DERATE (90 °C)	QTY OF CURRENT CARRYING CONDUCTORS	CONDUIT FILL DERATE	MINIMUM CONDUIT SIZE (TBD ON SITE)	WIRE GAUGE & TYPE	CONDUCTOR AMPACITY @ 90°C (A)	CONDUCTOR AMPACITY @ 75°C (A)	REQUIRED CIRCUIT CONDUCTOR AMPACITY (A)	ADJUSTED CONDUCTOR AMPACITY @ 90 °C (A)	NEUTRAL CONDUCTOR SIZE & TYPE	GROUND WIRE SIZE & TYPE
1	27	1	6	0.80	3/4" METAL	#10 THWN-2	40	35	14.50	32.00	NONE	#8 THWN-2
2	27	1	2	1.00	3/4" METAL	#8 THWN-2	55	50	43.50	55.00	#8 THWN-2	#8 THWN-2
3	27	1	2	1.00	1-1/4" PVC	#4 THWN-2	95	85	43.50	95.00	#4 THWN-2	#8 THWN-2
4	27	1	2	1.00	3/4" METAL	#8 THWN-2	55	50	43.50	55.00	#8 THWN-2	#8 THWN-2
5	27	1	2	1.00	3/4" METAL	#6 THWN-2	75	65	43.50	75.00	#6 THWN-2	#8 THWN-2

# GENERAL NOTES

## SITE NOTES

- 2.1.1 A LADDER WILL BE IN PLACE FOR INSPECTION IN ACCORDANCE WITH OSHA REGULATIONS.
- 2.1.2 THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- 2.1.3 THE SOLAR PV INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- 2.1.4 PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED IN ACCORDANCE WITH SECTION NEC 110.26.
- 2.1.5 ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SERVES TO PROTECT THE BUILDING OR STRUCTURE.

## EQUIPMENT LOCATIONS

- 2.2.1 ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS IN ACCORDANCE WITH NEC 110.26.
- 2.2.2 WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC 690.31 (A),(C) AND NEC TABLES 310.15 (B)(2)(A) AND 310.15 (B)(3)(C).
- 2.2.3 JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES IN ACCORDANCE WITH NEC 690.34.
- 2.2.4 ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT.
- 2.2.5 ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL IN ACCORDANCE WITH NEC APPLICABLE CODES.
- 2.2.6 ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

## STRUCTURAL NOTES

- 2.3.1 RACKING SYSTEM & PV ARRAY WILL BE INSTALLED IN ACCORDANCE WITH THE CODE-COMPLIANT INSTALLATION MANUAL. TOP CLAMPS REQUIRE A DESIGNATED SPACE BETWEEN MODULES, AND RAILS MUST ALSO EXTEND A MINIMUM DISTANCE BEYOND EITHER EDGE OF THE ARRAY/SUBARRAY, IN ACCORDANCE WITH RAIL MANUFACTURER'S INSTALLATION PRACTICES.
- 2.3.2 JUNCTION BOX WILL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS. IF ROOF-PENETRATING TYPE, IT SHALL BE FLASHED & SEALED PER LOCAL REQUIREMENTS.

## WIRING & CONDUIT NOTES

- 2.4.1 ALL CONDUIT AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.
- 2.4.2 CONDUCTORS SIZED IN ACCORDANCE WITH THE NEC
- 2.4.3 AC CONDUCTORS TO BE COLORED OR MARKED PER NEC
- 2.4.4 LISTED OR LABELED EQUIPMENT SHALL BE INSTALLED AND USED IN ACCORDANCE WITH ANY INSTRUCTIONS INCLUDED IN THE LISTING OR LABELING PER NEC

## GROUNDING NOTES

- 2.5.1 GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVICES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR SUCH USE.
- 2.5.2 PV EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH NEC 690.43 AND NEC TABLE 250.122.
- 2.5.3 METAL PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURES CONSIDERED GROUNDED IN ACCORDANCE WITH NEC 250.134 AND 250.136(A).
- 2.5.4 EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH NEC 690.45 AND INVERTER MANUFACTURER'S INSTALLATION PRACTICES
- 2.5.5 EACH MODULE WILL BE GROUNDED AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ.
- 2.5.6 THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.
- 2.5.7 GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLORED GREEN OR MARKED GREEN IF #4 AWG OR LARGER PER NEC 250.119
- 2.5.8 THE GROUNDING ELECTRODE SYSTEM COMPLIES WITH NEC 690.47 AND NEC 250.50 THROUGH 250.106. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM PROVIDED IN ACCORDANCE WITH NEC 250, NEC 690.47 AND THE AHJ.
- 2.5.9 GROUND-FAULT DETECTION SHALL COMPLY WITH NEC 690.41(B)(1) AND (2) TO REDUCE FIRE HAZARDS

## DISCONNECTION AND OVERCURRENT PROTECTION NOTES

- 2.6.1 DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING ENERGIZED ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS).
- 2.6.2 DISCONNECTS TO BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
- 2.6.3 PV SYSTEM CIRCUITS INSTALLED ON OR IN HABITABLE BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION TO REDUCE SHOCK HAZARD FOR EMERGENCY RESPONDERS IN ACCORDANCE WITH 690.12
- 2.6.4 ALL OCPD RATINGS AND TYPES SPECIFIED ACCORDING TO NEC 690.8, 690.9, AND 240.
- 2.6.5 INVERTER ON-GRID BRANCHES SHALL BE CONNECTED TO A SINGLE BREAKER OR GROUPED FUSE DISCONNECT(S) IN ACCORDANCE WITH NEC 110.3(B).
- 2.6.6 IF REQUIRED BY THE AHJ, SYSTEM WILL INCLUDE ARC-FAULT CIRCUIT PROTECTION IN ACCORDANCE WITH NEC 690.11 AND UL1699B.

## INTERCONNECTION NOTES

- 2.7.1 LOAD SIDE INTERCONNECTION SHALL BE IN ACCORDANCE WITH NEC 705.12.
- 2.7.2 THE SUM OF THE UTILITY OCPD AND INVERTER CONTINUOUS OUTPUT MAY NOT EXCEED 120 PERCENT OF BUSBAR RATING PER NEC 705.12.
- 2.7.3 THE SUM OF 125 PERCENT OF THE POWER SOURCE(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR, PV DEDICATED BACKFEED BREAKERS MUST BE LOCATED OPPOSITE END OF THE BUS FROM THE UTILITY SOURCE OCPD IN ACCORDANCE WITH NEC 705.12.
- 2.7.4 AT MULTIPLE ELECTRIC POWER SOURCES OUTPUT COMBINER PANEL, TOTAL RATING OF ALL OVERCURRENT PROTECTION DEVICES SHALL NOT EXCEED AMPACITY OF BUSBAR. HOWEVER, THE MAIN OVERCURRENT PROTECTION DEVICE MAY BE EXCLUDED IN ACCORDANCE WITH NEC 705.12.
- 2.7.5 FEEDER TAP INTERCONNECTION (LOAD SIDE) IN ACCORDANCE WITH NEC 705.12.
- 2.7.6 SUPPLY SIDE TAP INTERCONNECTION IN ACCORDANCE WITH TO NEC 705.12 WITH SERVICE ENTRANCE CONDUCTORS IN ACCORDANCE WITH NEC 230.42.
- 2.7.7 BACKFEEDING BREAKER FOR ELECTRIC POWER SOURCES OUTPUT IS EXEMPT FROM ADDITIONAL FASTENING PER NEC 705.12.

## CONTRACTOR



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY,  
MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690

## PROJECT NAME & ADDRESS

RICH HUFFAM

64 ISLAND FARMS RD,  
WEST TISBURY, MA 02575  
APN #: WTISM00016B00017L00000

AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

## SYSTEM DETAILS

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

## REVISIONS

REV	DESCRIPTION	DATE

## SHEET TITLE

**NOTES**

DRAWN DATE	2/1/2024
DRAWN BY	PCAD

## SHEET NUMBER

**PV-05**

**WARNING**

ELECTRICAL SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION: COMBINER PANEL, AC DISCONNECT, POINT OF INTERCONNECTION PER CODE: NEC 706.15(C)(4), NEC 690.13(B)

**WARNING**

TURN OFF PHOTOVOLTAIC AC DISCONNECT PRIOR TO WORKING INSIDE PANEL

LABEL LOCATION: COMBINER PANEL(S), MAIN SERVICE DISCONNECT PER CODE: NEC 110.27(C), OSHA 1910.145(f)(7)

**PHOTOVOLTAIC POWER SOURCE**

LABEL LOCATION: DC CONDUIT/RACEWAYS PER CODE: NEC 690.31(D)(2)

**SOLAR PV DC CIRCUIT**

LABEL LOCATION: DC CONDUIT/RACEWAYS PER CODE: NEC 690.31(D)(2)

**PHOTOVOLTAIC SYSTEM AC DISCONNECT**

RATED AC OUTPUT CURRENT: 34.80 A  
NOMINAL OPERATING AC VOLTAGE: 240 V

LABEL LOCATION: AC DISCONNECT/POINT OF INTERCONNECTION PER CODE: NEC 690.54

**WARNING DUAL POWER SOURCE  
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM**

LABEL LOCATION: MAIN SERVICE DISCONNECT, PRODUCTION/NET METER PER CODE: NEC 690.59, 705.12(C)

**PV SYSTEM**

**DISCONNECT**

LABEL LOCATION: AC DISCONNECT PER CODE: NEC 690.13(B)

**WARNING**

THIS EQUIPMENT FED BY MULTIPLE SOURCES: TOTAL RATING OF ALL OVERCURRENT DEVICES EXCLUDING MAIN POWER SUPPLY SHALL NOT EXCEED AMPACITY OF BUSBAR


LABEL LOCATION: AC DISCONNECT PER CODE: NEC 705.12(B)(3)(3)

**WARNING  
POWER SOURCE OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE.**

LABEL LOCATION: POINT OF INTERCONNECTION PER CODE: NEC 705.12(B)(3)(2)

**SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN**

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



LABEL LOCATION: MAIN SERVICE DISCONNECT PER CODE: NEC 690.56(C)

**MAIN PHOTOVOLTAIC SYSTEM DISCONNECT**

LABEL LOCATION: MAIN SERVICE DISCONNECT, UTILITY METER PER CODE: NEC 690.13(B)

**RAPID SHUTDOWN FOR SOLAR PV SYSTEM**

LABEL LOCATION: RSD INITIATION DEVICE, AC DISCONNECT PER CODE: NEC 690.56(C)(2)

**CAUTION  
PHOTOVOLTAIC SYSTEM CIRCUIT IS BACKFED**

LABEL LOCATION: MAIN SERVICE DISCONNECT PER CODE: NEC 705.12(D), NEC 690.59

**DO NOT DISCONNECT UNDER LOAD**

LABEL LOCATION: MAIN SERVICE DISCONNECT PER CODE: NEC 690.15(B) & NEC 690.33(D)(2)

**MAXIMUM DC VOLTAGE**

**OF PV SYSTEM**

LABEL LOCATION: DC DISCONNECT/INVERTER/PV DIST. EQUIPMENT PER CODE: NEC 690.53

**WARNING**

ELECTRICAL SHOCK HAZARD


TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT

LABEL LOCATION: DC DISCONNECT PER CODE: NEC 690.13(B)

**PV METER**

LABEL LOCATION: PV METER

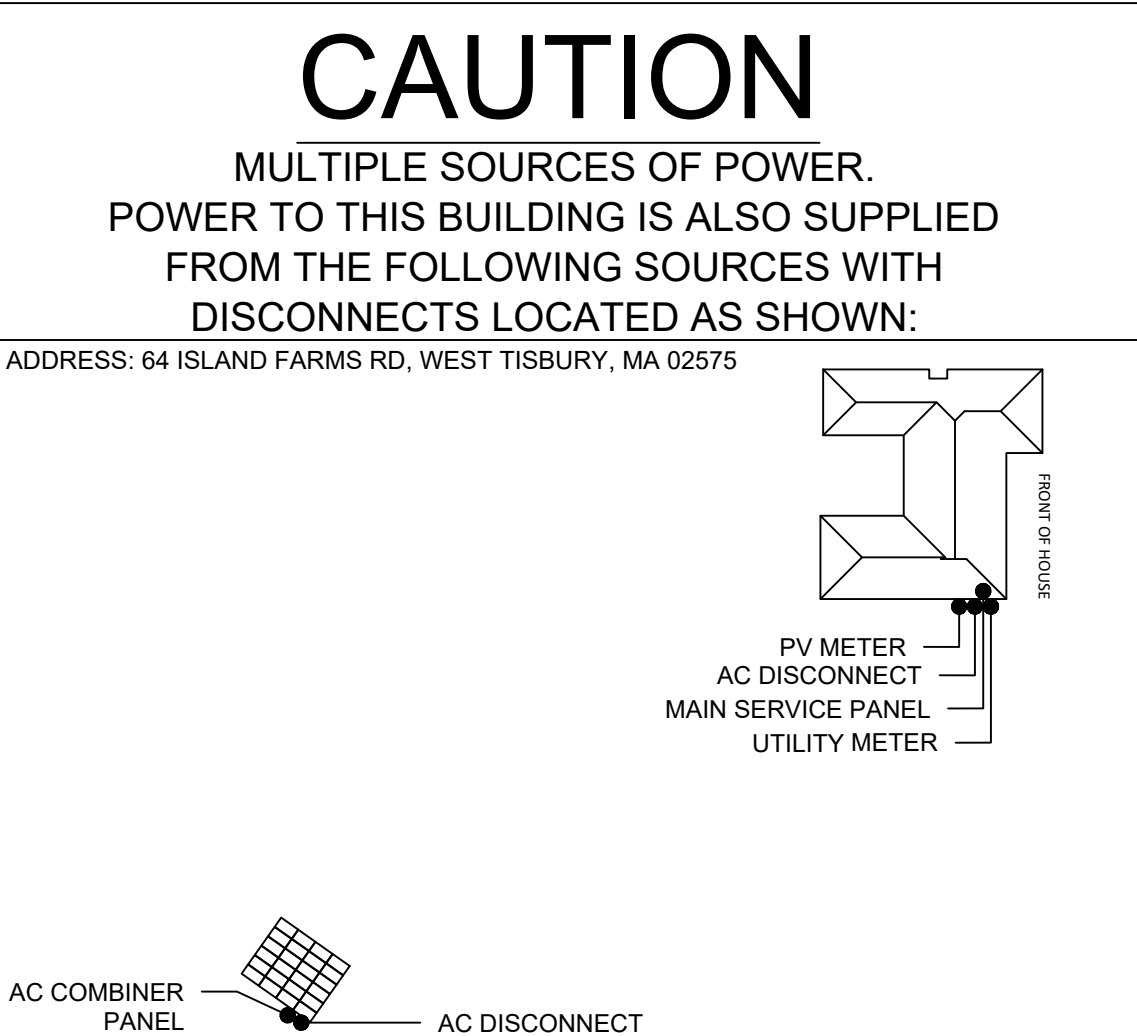

CONTRACTOR



FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY, MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690

**PROJECT NAME & ADDRESS**

RICH HUFFAM

64 ISLAND FARMS RD, WEST TISBURY, MA 02575

APN #: WTISM00016B00017L00000

AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

**SYSTEM DETAILS**

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

**REVISIONS**

REV	DESCRIPTION	DATE

**SHEET TITLE**

**WARNING LABELS**

DRAWN DATE 2/1/2024

DRAWN BY PCAD

**SHEET NUMBER**

**PV-06**

# REFERENCE ONLY


CONTRACTOR




FARLEY BUILT, INC

PO BOX 1491, WEST TISBURY,  
MA 02575

PHONE - (508) 560-3400  
LIC. NO. - 96690



	A	B	C	D	E	F
1						
2						
3						
4						
5						
6						
7						
8						
9						
10						

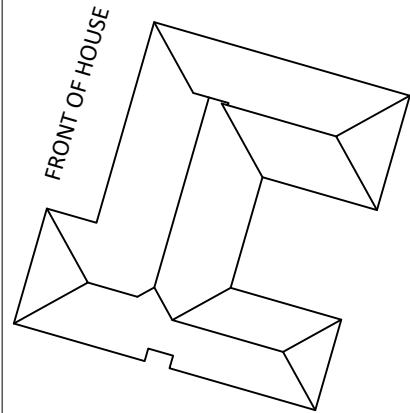

**PROJECT NAME & ADDRESS**

RICH HUFFAM

64 ISLAND FARMS RD,  
WEST TISBURY, MA 02575

APN #: WTISM00016B00017L00000

AHJ: TOWN OF WEST TISBURY  
UTILITY: EVERSOURCE

**SYSTEM DETAILS**

DC SIZE: 9.840 KW DC-(STC)  
AC SIZE: 8.376 KW AC  
(24) HYUNDAI SOLAR HIS-S410YH(BK)  
(24) ENPHASE IQ8A-72-2-US [240V]

**REVISIONS**

REV	DESCRIPTION	DATE

**SHEET TITLE  
INSTALLATION  
RESOURCE**

DRAWN DATE 2/1/2024

DRAWN BY PCAD

**SHEET NUMBER**

PV-07




# HYUNDAI SOLAR MODULE

**YH**  
SERIES

## Dual Black Max

HiS-S385YH(BK) HiS-S390YH(BK) HiS-S395YH(BK)  
HiS-S400YH(BK) HiS-S405YH(BK) **HiS-S410YH(BK)**

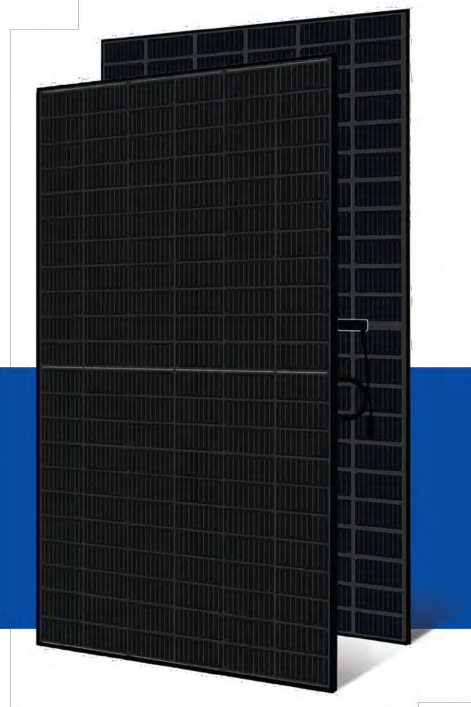

Bifacial Cells  
**132**



More Power Generation  
In Low Light



All black Module  
For Sleek Design  
(Black Meshed  
T-Backsheet)



Hyundai Cell



### Maximized Power Generation

Increased total power output through capturing light from both the front and back of Bifacial solar modules. Back side power gain up to 25% of the front output depending on PV system design.



### Mechanical Strength

Tempered glass and reinforced frame design withstand rigorous weather conditions such as heavy snow(5,400Pa) and strong wind(5,400Pa).



### Half-Cut & Multi-Wire Technology

Improved current flow with half-cut technology and 9 thin wiring technology allows high module efficiency of up to 20.5%. It also reduces power generation loss due to micro-cracks.



### UL / VDE Test Labs

Hyundai's R&D center is an accredited test laboratory of both UL and VDE.



### Anti-LID / PID

Both LID(Light Induced Degradation) and PID(Potential Induced Degradation) are significantly reduced to ensure higher actual yield during lifetime.



### Reliable Warranty

Global brand with powerful financial strength provide reliable 25-year warranty.

### Hyundai's Warranty Provisions

**25 YEARS** • 25-Year Product Warranty  
• Materials and workmanship

**25 YEARS** • 25-Year Performance Warranty  
• Initial year : 98.0%  
• Linear warranty after second year:  
with 0.54%p annual degradation,  
85.0% is guaranteed up to 25 years

### About Hyundai Energy Solutions

Established in 1972, Hyundai Heavy Industries Group is one of the most trusted names in the heavy industries sector and is a Fortune 500 company. As a global leader and innovator, Hyundai Heavy Industries is committed to building a future growth engine by developing and investing heavily in the field of renewable energy.

As a core energy business entity of HHI, Hyundai Energy Solutions has strong pride in providing high-quality PV products to more than 3,000 customers worldwide.

### Certification



UL61730 certified by UL, Type 1(for Fire Class A)



### Electrical Characteristics

		Mono-Crystalline Type(HiS-S___YH(BK))					
		385	390	395	400	405	410
Nominal Output (P <sub>mpp</sub> )	W	385	390	395	400	405	410
Open Circuit Voltage (V <sub>oc</sub> )	V	44.5	44.8	45.0	45.3	45.6	45.9
Short Circuit Current (I <sub>sc</sub> )	A	11.04	11.11	11.18	11.25	11.33	11.40
Voltage at P <sub>max</sub> (V <sub>mpp</sub> )	V	37.1	37.3	37.5	37.7	37.9	38.1
Current at P <sub>max</sub> (I <sub>mp</sub> )	A	10.40	10.47	10.54	10.61	10.69	10.76
Module Efficiency	%	19.3	19.5	19.8	20.0	20.3	20.5
Cell Type	-	Mono crystalline, 9busbar					
Maximum System Voltage	V	1,500					
Temperature Coefficient of P <sub>max</sub>	%/K	-0.347					
Temperature Coefficient of V <sub>oc</sub>	%/K	-0.268					
Temperature Coefficient of I <sub>sc</sub>	%/K	+0.032					

\*All data at STC / Measurement tolerances P<sub>mpp</sub> ±3%; I<sub>sc</sub> ; V<sub>oc</sub> ±3%. Above data may be changed without prior notice.

Additional Power Gain from rear side		385	390	395	400	405	410
5%	W	399	404	410	415	425	431
15%	W	437	443	449	454	466	472
25%	W	475	482	488	494	506	513

### Mechanical Characteristics

Dimensions	1,924 mm (L) x 1,038 mm (W) x 32 mm (H)
Weight	Approx. 21.1 kg
Solar Cells	132 half cut bifacial cells (2 parallel x 66 half cells in series)
Output Cables	Cable : 1,200mm / 4mm <sup>2</sup> Connector : MC4 genuine connector
Junction Box	IP68, weatherproof, IEC certified (UL listed)
Bypass Diodes	3 bypass diodes to prevent power decrease by partial shade
Construction	Front : 3.2mm, High Transmission, AR Coated Tempered Glass Encapsulant : EVA   Back Sheet : Black Meshed Transparent Backsheet
Frame	Anodized aluminum alloy type 6063



### Installation Safety Guide

- Only qualified personnel should install or perform maintenance.
- Be aware of dangerous high DC voltage.
- Do not damage or scratch the rear surface of the module.
- Do not handle or install modules when they are wet.



Nominal Operating Cell Temperature	45.5°C ± 2°C
Operating Temperature	-40°C ~ +85°C
Maximum System Voltage	DC 1,500V
Maximum Reverse Current	20A
Maximum Test Load	Front 5,400 Pa (113 psf) Rear 5,400 Pa (113 psf)

### Module Diagram (unit : mm)


Front Side View

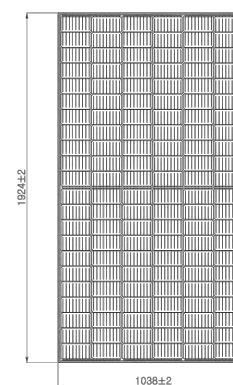


Rear Side View

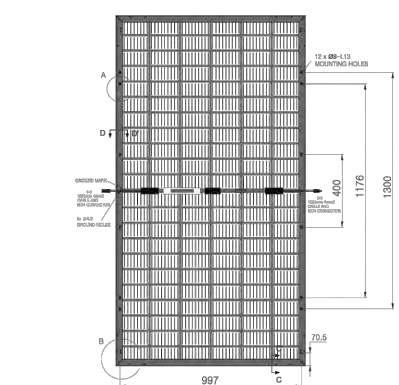

Current [A]

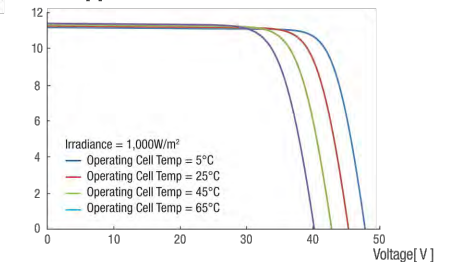

Current [A]

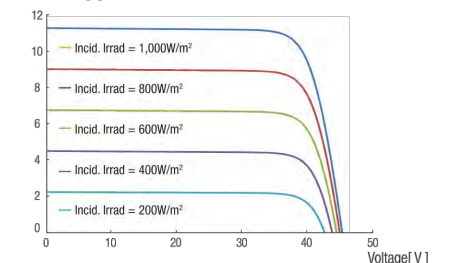





# IQ8M and IQ8A Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, software defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has superfast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the IQ Battery, IQ Gateway, and the Enphase App monitoring and analysis software.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters are UL listed as PV Rapid Shutdown Equipment and conform with various regulations, when installed according to manufacturer's instructions.

### Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

### High productivity and reliability

- Produce power even when the grid is down\*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

### Microgrid-forming

- Complies with the latest advanced grid support\*\*
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) and IEEE 1547:2018 (UL 1741-SB 3<sup>rd</sup> Ed.)

**Note:**

IQ8 Microinverters cannot be mixed together with previous generations of Enphase microinverters (IQ7 Series, IQ6 Series, etc) in the same system.

# IQ8M and IQ8A Microinverters

INPUT DATA [DC]		IQ8M-72-2-US	IQ8A-72-2-US
Commonly used module pairings <sup>1</sup>	W	260 – 460	295 – 500
Module compatibility		54-cell / 108 half-cell, 60-cell / 120 half-cell, 66-cell / 132 half-cell and 72-cell / 144 half-cell	
MPPT voltage range	V	30 – 45	32 – 45
Operating range	V		16 – 58
Min. / Max. start voltage	V		22 / 58
Max. input DC voltage	V		60
Max. continuous input DC current	A		12
Max. input DC short-circuit current	A		25
Max. module I <sub>sc</sub>	A		20
Overvoltage class DC port			II
DC port backfeed current	mA		0
PV array configuration		1 x 1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit	
OUTPUT DATA [AC]		IQ8M-72-2-US	IQ8A-72-2-US
Peak output power	VA	330	366
Max. continuous output power	VA	325	349
Nominal (L-L) voltage / range <sup>2</sup>	V		240 / 211 – 264
Max. continuous output current	A	1.35	1.45
Nominal frequency	Hz		60
Extended frequency range	Hz		47 – 68
AC short circuit fault current over 3 cycles	Arms		2
Max. units per 20 A (L-L) branch circuit <sup>3</sup>			11
Total harmonic distortion			<5%
Overvoltage class AC port			III
AC port backfeed current	mA		30
Power factor setting			1.0
Grid-tied power factor (adjustable)			0.85 leading – 0.85 lagging
Peak efficiency	%	97.8	97.7
CEC weighted efficiency	%	97.5	97
Night-time power consumption	mW		60
MECHANICAL DATA			
Ambient temperature range		-40°C to +60°C (-40°F to +140°F)	
Relative humidity range		4% to 100% (condensing)	
DC Connector type		MC4	
Dimensions (H x W x D)		212 mm (8.3") x 175 mm (6.9") x 30.2 mm (1.2")	
Weight		1.08 kg (2.38 lbs)	
Cooling		Natural convection – no fans	
Approved for wet locations		Yes	
Pollution degree		PD3	
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure	
Environ. category / UV exposure rating		NEMA Type 6 / outdoor	
COMPLIANCE			
Certifications		CA Rule 21 (UL 1741-SA), UL 62109-1, IEEE 1547:2018 (UL 1741-SB 3 <sup>rd</sup> Ed.), FCC Part 15 Class B, ICES-0003 Class B, CAN / CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shutdown Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.	

(1) Pairing PV modules with wattage above the limit may result in additional clipping losses. See the compatibility calculator at <https://link.enphase.com/module-compatibility>. (2) Nominal voltage range can be extended beyond nominal if required by the utility. (3) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

\*Only when installed with IQ System Controller 2, meets UL 1741.  
\*\*IQ8M and IQ8A support split-phase, 240V installations only.



# Enphase IQ Combiner 4/4C

X-IQ-AM1-240-4  
X-IQ-AM1-240-4C



The **Enphase IQ Combiner 4/4C** with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

### Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

### Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

### Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ Combiner 4/4C

### MODEL NUMBER

IQ Combiner 4 (X-IQ-AM1-240-4)	IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes a silver solar shield to match the IQ Battery system and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C)	IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.

### ACCESSORIES AND REPLACEMENT PARTS (not included, order separately)

Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	- Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan for Ensemble sites - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C
X-IQ-NA-HD-125A	Hold down kit for Eaton circuit breaker with screws.

### ELECTRICAL SPECIFICATIONS

Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating	65 A
Max. continuous current rating (input from PV/storage)	64 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation / 95A with IQ Gateway breaker included
Envoy breaker	10A or 15A rating GE/Siemens/Eaton included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway
Consumption monitoring CT (CT-200-SPLIT)	A pair of 200 A split core current transformers

### MECHANICAL DATA

Dimensions (WxHxD)	37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	<ul style="list-style-type: none"> <li>• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors</li> <li>• 60 A breaker branch input: 4 to 1/0 AWG copper conductors</li> <li>• Main lug combined output: 10 to 2/0 AWG copper conductors</li> <li>• Neutral and ground: 14 to 1/0 copper conductors</li> </ul> Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)

### INTERNET CONNECTION OPTIONS

Integrated Wi-Fi	802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)

### COMPLIANCE

Compliance, IQ Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)


© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 02-14-2022





## Enphase Q Cable Accessories

The **Enphase Q Cable™** and accessories are part of the latest generation Enphase IQ System™. These accessories provide simplicity, reliability, and faster installation times.

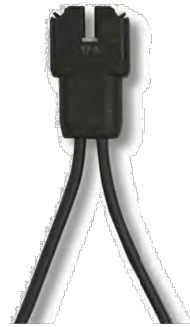

### Enphase Q Cable

- Two-wire, double-insulated Enphase Q Cable is 50% lighter than the previous generation Enphase cable
- New cable numbering and plug and play connectors speed up installation and simplify wire management
- Link connectors eliminate cable waste



### Field-Wireable Connectors

- Easily connect Q cables on the roof without complex wiring
- Make connections from any open connector and center feed any section of cable within branch limits
- Available in male and female connector types





## Enphase Q Cable Accessories

CONDUCTOR SPECIFICATIONS	
Certification	UL3003 (raw cable), UL 9703 (cable assemblies), DG cable
Flame test rating	FT4
Compliance	RoHS, OIL RES I, CE, UV Resistant, combined UL for Canada and United States
Conductor type	THHN/THWN-2 dry/wet
Disconnecting means	The AC and DC bulkhead connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.

Q CABLE TYPES / ORDERING OPTIONS				
Connectorized Models	Size / Max Nominal Voltage	Connector Spacing	PV Module Orientation	Connector Count per Box
Q-12-10-240	12 AWG / 277 VAC	1.3 m (4.2 ft)	Portrait	240
Q-12-17-240	12 AWG / 277 VAC	2.0 m (6.5 ft)	Landscape (60-cell)	240
Q-12-20-200	12 AWG / 277 VAC	2.3 m (7.5 ft)	Landscape (72-cell)	200

ENPHASE Q CABLE ACCESSORIES		
Name	Model Number	Description
Raw Q Cable	Q-12-RAW-300	300 meters of 12 AWG cable with no connectors
Field-wireable connector (male)	Q-CONN-10M	Make connections from any open connector
Field-wireable connector (female)	Q-CONN-10F	Make connections from any Q Cable open connector
Cable Clip	Q-CLIP-100	Used to fasten cabling to the racking or to secure looped cabling
Disconnect tool	Q-DISC-10	Disconnect tool for Q Cable connectors, DC connectors, and AC module mount
Q Cable sealing caps (female)	Q-SEAL-10	One needed to cover each unused connector on the cabling
Terminator	Q-TERM-10	Terminator cap for unused cable ends
Enphase EN4 to MC4 adaptor <sup>1</sup>	ECA-EN4-S22	Connect PV module using MC4 connectors to IQ micros with EN4 (TE PV4-S SOLARLOK). 150mm/5.9" to MC4.
Enphase EN4 non-terminated adaptor <sup>1</sup>	ECA-EN4-FW	For field wiring of UL certified DC connectors. EN4 (TE PV4-S SOLARLOK) to non-terminated cable. 150mm/5.9"
Enphase EN4 to MC4 adaptor (long) <sup>1</sup>	ECA-EN4-S22-L	Longer adapter cable for EN4 (TE PV4-S SOLARLOK) to MC4. Use with split cell modules or PV modules with short DC cable. 600mm/23.6"
Replacement DC Adaptor (MC4)	Q-DCC-2	DC adaptor to MC4 (max voltage 100 VDC)
Replacement DC Adaptor (UTX)	Q-DCC-5	DC adaptor to UTX (max voltage 100 VDC)

1. Qualified per UL subject 9703.

	<b>TERMINATOR</b> Terminator cap for unused cable ends, sold in packs of ten (Q-TERM-10)		<b>SEALING CAPS</b> Sealing caps for unused aggregator and cable connections (Q-BA-CAP-10 and Q-SEAL-10)
	<b>DISCONNECT TOOL</b> Plan to use at least one per installation, sold in packs of ten (Q-DISC-10)		<b>CABLE CLIP</b> Used to fasten cabling to the racking or to secure looped cabling, sold in packs of one hundred (Q-CLIP-100)

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enphase IQ 7A, Enphase IQ Battery, Enphase Enlighten, Enphase IQ Envoy, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change.  
 2020-06-26






**We track at any scale.**  
Utility-scale models also available

## More power to you.

DualTrack 24 captures the most optimal energy for your home, thanks to our patented Real-Time Sensors (RTS) that guide our systems to the maximum point of sunlight throughout the day. This results in **30-40 percent more** power production than conventional fixed arrays.

Rating chart using a sunny day

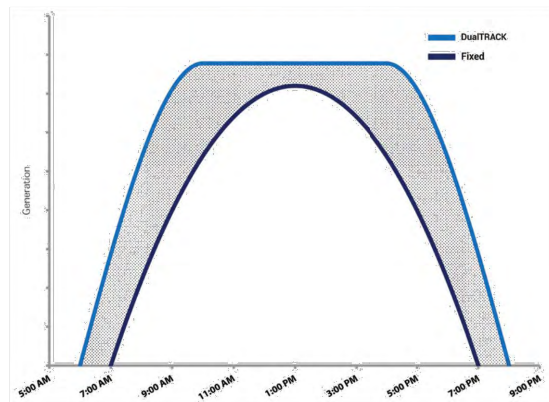

## Key features

### Reliability

Contains self-healing Magnesium Alloy Coated (MAC) steel, a strong alloy that is 5-10 times stronger than galvanized steel.

Utilizes patented Real-Time Sensors for ultimate tracking, allowing **no wasted energy** during cloudy days - unlike conventional GPS input tracking systems that follow their pre-programmed path.

We provide company support during the lifetime of the tracker (Operation & Troubleshooting)

### Installation Flexibility

Simple electrical Plug N' Play connection with the use of RTS technology. No pre-programming or skilled technician is required.

Can be installed on any terrain.


Flexible system that can accommodate any commercially available solar module.

### Low Maintenance

Low voltage DC motors which require low maintenance and minimum downtime.

No skilled technician is required.

Learn more about Real-Time Sensing

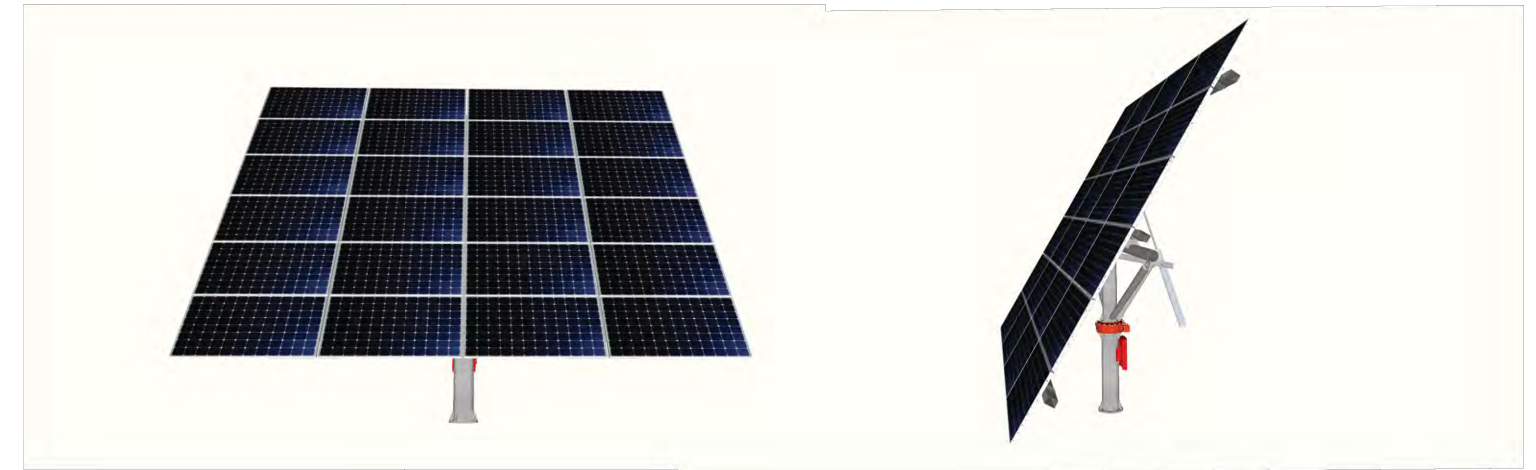

## Tracker Specifications

Tracking Type	Dual Axis
Model	DualTrack 24
Module Area (Max)*	48m <sup>2</sup> [24 modules 72-cell]
System Weight	1,500kg, without modules & foundation
Tracking Axis	Dual Axis: azimuth & vertical
Tracking Range of Motion	Azimuth: -120° to +120° Vertical: 0° to 60°
Azimuth Rotation	Slew drive
Vertical Tilt	Linear actuator
Power Supply to Controller	100-240VAC / 50 ~ 60Hz
Materials	Magnesium Alloy Coated / Hot-dip Galvanized steel
Solar Tracking Method	Real-Time Solar Sensor
Max Wind Speed	Standard 47m/s (105MPH)
Safety Mode (Automatic Horizontal)	Wind mode, Less than 3,000 lux
Safety Mode (Tilted Position)	Snow Mode
Temperature Range	-25 to 55°C (-13 to 131°F)

*The above specifications could vary according to local conditions  
\*Module Area (Max) - Optional 60 cell modules*

**Available for Residential, Commercial & Industrial use.**

### Sun Action Trackers

3660 Thousand Oaks, Suite 316 | San Antonio, Texas 78247  
Main: 844-366-7525  
Email: info@sat-energy.com

[www.sat-energy.com](http://www.sat-energy.com)



# CERTIFICATE OF COMPLIANCE

**Certificate Number** 20211109-E341165  
**Report Reference** E341165-20210317  
**Issue Date** 2021-11-09

**Issued to:** Enphase Energy Inc.  
1420 N. McDowell Blvd. Petaluma, CA 94954-6515

**This is to certify that representative samples of** Grid Support, Utility Interactive Supporting Energy Storage, Multimode, Bi-directional Microinverters

Models IQ8-60, IQ8PLUS-72, IQ8M-72, IQ8A-72, IQ8H-208-72, IQ8H-240-72, may be f/b -2, -5, -E, or -M, may be f/b -ACM, f/b -US, may be f/b -NM, may be f/b -RMA, may be f/b -&, where "&" designates additional characters.

Has been investigated by UL in accordance with the Standard(s) indicated on this Certificate.


**Standard(s) for Safety:** See Page 2

**Additional Information:** See the UL Online Certifications Directory at [www.ul.com/database](http://www.ul.com/database) for additional information

This *Certificate of Compliance* is provided as a courtesy to help our customers communicate product compliance information, as documented in our UL Follow-Up Services procedure. This Certificate of Compliance does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark shall be considered as being UL Certified and covered under UL's Follow-Up Services. Look for the UL Certification Mark on the product.

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL.



Bruce Mahrenholz, Director North American Certification Program  
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/about/locations/>



# CERTIFICATE OF COMPLIANCE

**Certificate Number** 20211109-E341165  
**Report Reference** E341165-20210317  
**Issue Date** 2021-11-09

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Standards for Safety:

UL 62109-1, STANDARD FOR SAFETY OF POWER CONVERTERS FOR USE IN PHOTOVOLTAIC POWER SYSTEMS - PART 1: GENERAL REQUIREMENTS, Edition 1, Revision Date 04/30/2019

IEC 62109-2, SAFETY OF POWER CONVERTERS FOR USE IN PHOTOVOLTAIC POWER SYSTEMS - PART 2: PARTICULAR REQUIREMENTS FOR INVERTERS, Edition 1, Issue Date 06/2011


UL 1741, Inverters, Converters, Controllers and Interconnection System Equipment for Use With Distributed Energy Resources, Edition 2, Revision Date 06/10/2021, including the requirements in UL 1741 Supplement SA, sections as noted in the Technical considerations.

IEEE 1547, IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems.

IEEE 1547.1, IEEE Standard for Conformance Test Procedures for Equipment Interconnecting Distributed Resources with Electric Power Systems.

CSA C22.2 No. 62109-1, Safety of Power Converters for Use in Photovoltaic Power Systems - Part 1: General Requirements, Edition 1, Issue Date 07/2016

CSA C22.2 No. 62109-2, Safety of Power Converters for Use in Photovoltaic Power Systems - Part 2: Particular Requirements for Inverters, Edition 1, Issue Date 07/2016



Bruce Mahrenholz, Director North American Certification Program  
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/about/locations/>

